



Power Meter Monitor

**Business and Mission-
Critical Solutions Provider**

12 x Digital Input 380VDC/AC

Data Sheet



Model: PMM0620-380

Document: Data Sheet

Document version: 1.0

Date: April 2022



COPYRIGHT NOTICE

The information in this document is subject to change without prior notice to improve reliability, design, and function and does not represent a commitment on the part of the manufacturer.

In no event will the manufacturer be liable for direct, indirect, special, incidental, or consequential damage arising out of the use or inability to use the product or documentation, even if advised of the possibility of such damages.

This document contains proprietary information protected by copyright. All rights are reserved. No part of this manual may be reproduced by any mechanical, electronic, or other means in any form without prior written permission of the manufacturer.

TRADEMARKS

All registered trademarks and product names mentioned herein are used for identification purposes only and may be trademarks and/or registered trademarks of their respective owners.

AMI is a trademark of American Megatrends Inc.

Intel & Atom are trademarks of Intel Corporation

IBM, PC/AT, PS/2&VGA are trademarks of International Business Machines Corporation Microsoft Windows is a trademark of Microsoft Corp. RTL is the trademark of Realtek Semiconductor Co., Ltd.

DECLARATION OF CONFORMITY

This restriction is subject to protect the operational process of the system in the business environment, which will produce, use, and transmit radiofrequency energy. Harmful interference to radio communication could result if instructions to the correct installation and usage were not applied. The interference prevention cannot be guaranteed even with proper installation according to the manual. If the device causes a bad effect on the radio / TV signal. The user could preclude that by turning the device on/off.

When this device produces some harmful interference, the user can use the following measure to solve the interference problem:

1-Setting the receiving antenna's direction or location to increase the distance between this device and receiver.

2-Plug in the device's power connector into different circuits of the power outlet with the receiver.

3-If any technical support is needed, the dealer or experienced radio/TV technical personnel must be informed.

TECHNICAL SUPPORT AND SERVICE

Visit Pmm-usa.us to browse FAQs and get further details.

User should collect the following information before submitting technical support and service requests:

- Product name, model and serial number.
- Installed software (operating system, OS version, installed applications and so on).
- Full description of the problem
- Detailed information about every error.

SAFETY INSTRUCTIONS

- Only trained and qualified personnel can install, operate, or maintain the device.
- Before starting the installation, all safety precautions must be read, and warning labels affixed to the device must be observed. Doing so protects the device from damage and ensures your safety.
- Safety precautions provided in this document may not cover all safety aspects, note to always remain mindful of safety.
- PMM is not liable for any consequence that results from violation of regulations pertaining to safe operations or safety codes pertaining to design, production, and equipment usage.
- DO NOT use liquids or decontamination spray to clean the device surface and assure that it is totally disconnected while cleaning.
- Take all measures to prevent device drop before or during installation.
- Prior to connecting the device to power source, ensure the source and device voltage and power are 100% matched.
- Keep the cables in a suitable covered place.
- If the device is not used for a long time, shut off the power to avoid the damages by transient overvoltage.
- DO NOT allow any liquid flow into the device; to avoid fire or short circuit.
- The recommended storage temperature range should NOT be less than 30°C OR higher than 85°C.



Warning:

- Read the power source and device inlet carefully.
- Handle device with both hands.
- Clean and maintain the device using recommended, safe and suitable methods.



Caution:

If any unauthorized changes of settings or repairs are done without PMM approval; then user's rights of controlling this device will be canceled.

Contents

DESCRIPTION4

KEY FEATURES.....4

TECHNICAL SPECIFICATIONS.....5

HARDWARE CONFIGURATION.....5

PIN ASSIGNMENTS.....6

HARDWARE CONNECTIONS.....6

 1. Connecting Power.....6

 2. Connecting Serial Device6

 3. Connecting Digital Input:6

ENCLOSURE DIMENSIONS7

KEY FEATURES

- 12 x Isolated Digital Input 380VDC/AC
- 32-bit ARM core CPU with 48 MHz clock
- Hot swap redundancy exchange and fail safe ready
- Stand-alone programming or Modular operation modes
- 1x Ethernet 10/100 port
- 1x Serial RS485 port with power surge $\pm 2.5\text{kV}$ isolation protection
- Overvoltage and reverse polarity protected
- Onboard Termination resistor via dip switch
- Wide range of power supply options (9-56 VDC)
- 5000V system/field isolation
- Simple to set up and cost effective
- High speed data read/write with high reliability and accuracy
- EMI, EMS, EMC and shock protected
- -40 to 80 °C Operating temperature
- 5% to 90% Non-condensing Relative Humidity
- Standard 35mm din rail mounting bracket

DESCRIPTION

PMM0620-380 is a reliable, and simple to set up digital Input module that has 12 isolated channels. The module receives analog signals from sensors and field devices of 380VDC/AC range. Then, the module converts the signal to 0-5 V scale to make the signals compatible with the CPU. In addition, the isolation feature provides high protection against ground potential differences between field signals and the CPU.

PMM0620-380 is widely used in signal interface switching of PLC, single chip or other industrial control board.

Moreover, PMM0620-380 operates under three operational modes:

- **Modular operation mode:** the module is connected to a PLC by RS485 and implement specific function assigned by the PLC.
- **Fail Safe mode:** the module should be pre-programmed in case of lost connection with the PLC to carry on its function effectively.
- **Stand-alone:** the module can be programmed to work as PLC and control the field devices.

In addition, PMM0620-380 industrial grade IO module can function under harsh environmental conditions of any site. It is reliable, easy to configure and has an extreme accuracy.

TECHNICAL SPECIFICATIONS

Interfaces

Serial	1x RSR85 port
Ethernet	1x 10/100
DI/DO	12 digital inputs 380VDC/AC
USB	1x USB2.0 Type micro-B
LED Indicators	1x LED for Tx and 1x LED for Rx for communication over RS485 port indication 12x LED for signals transmission indication

Power Parameters

Input Power Supply Options	9-56 VDC (10-40 VAC)
Power Connector	Phoenix Contact 4 pins 3.5mm


Physical Characteristics

Housing	Polyamide (Nylon 6.66)/PA
Dimensions	3.91x4.37x0.99 inch (99.4x111.2x22.6 mm)
Mounting Options	DIN Rail

HARDWARE CONFIGURATION


Termination resistor is needed to avoid data-corrupting reflections and expand the network between D+ and D- lines for the RS485.

- Turn on the dip switch (closed circuit) to have a termination resistor of 120Ω between D+ and D- lines.
- The other dip switch is for PROG mode, it is used to switch between two customized modes. As shown in the figure below.

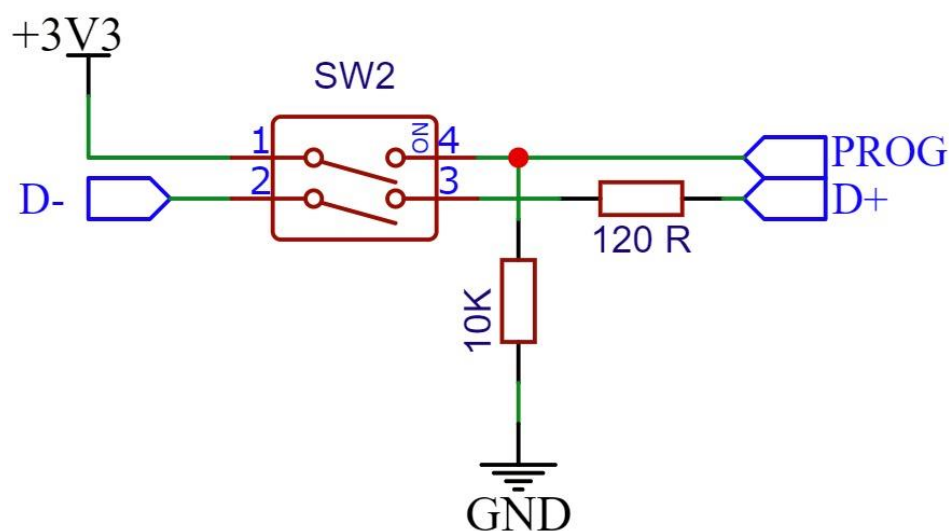


PIN ASSIGNMENTS

TOP VIEW

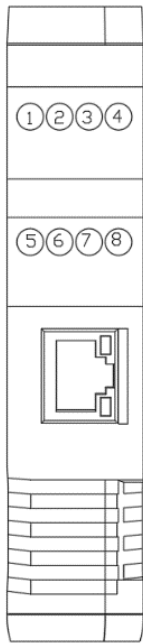

1. D+ (RS485)
2. D- (RS485)
3. Common
4. Common
5. V DC+ (9-56)
6. V DC- (9-56)
7. Earth
8. Earth

BOTTOM VIEW

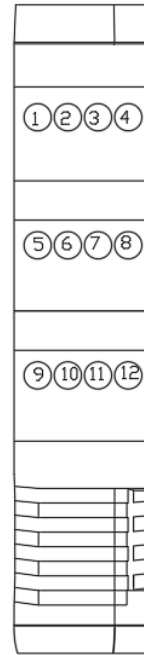

1. Digital Input 01
2. Digital Input 02
3. Digital Input 03
4. Digital Input 04
5. Digital Input 05
6. Digital Input 06
7. Digital Input 07
8. Digital Input 08
9. Digital Input 09
10. Digital Input 10
11. Digital Input 11
12. Digital Input 12

HARDWARE CONNECTIONS

1. Connecting Power

PMM0620-380 has two power supply options 9-56V DC or 10-40 V AC, the user has to connect the positive power line (+) to pin no.5 in the top view and the negative line (-) to pin no.6 as illustrated in the pin's assignments.

Note: the power is protected against overvoltage and reverse polarity in case of wrong connection.

2. Connecting Serial Device

The unit's serial port is located on the top panel. If you are connecting an RS485 multidrop network with multiple devices, note the following:

- All devices that are connected to a single serial port must use the same protocol (i.e., either Modbus RTU or Modbus ASCII).
- Connect the D+ with pin no.1 and D- with pin no.2 and Earth with pin no.4 as illustrated in the pin's assignments to complete the connection successfully.
- Turn on the dip switch to have 120 Ω termination resistor between the D+ and D- lines. Refer hardware configuration section.

3. Connecting Digital Input:

Connect the signal line with one of the twelve digital input pins on the bottom view (01-12) and the common line with pin no.3 or 4.

4. Connecting to a Host or the Network

There is a 10/100 Ethernet port at the module's top panel. This port is used to connect the module with a host or Ethernet network.

ENCLOSURE DIMENSIONS

